

**EZ TRAP®**

# EZ TRAP®

U.S. Patent Numbers 5,069,042 5,522,229

Model No.


# 83119

(EZT 119)

## Kit Contents


- 1" Standard Trap (1)
- 1" Cross (1)
- 1" Tee (1)
- 1" X 3/4" Male Adaptor (1)
- Reducing Bushing (1)
- 3/4" Black Stub (1)
- Red Caps (2)
- Yellow Cleaning Label (1)
- Cleaning Brush (1)

Scan for more info



## 1" High Flow Commercial Condensate Trap

1" DROP

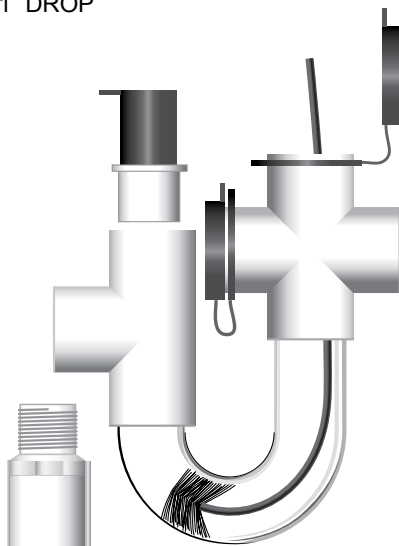

**2 Year**

**LIMITED WARRANTY.** RectorSeal® warrants to the original consumer purchaser ("Purchaser") of its product, EZ Trap®, that it is free from defects in material or workmanship. If within two years (24 months) from the date of the original consumer purchase this product shall prove to be defective, it shall be repaired or replaced at RectorSeal's option. Your original receipt of purchase is required to determine warranty eligibility.

RectorSeal® 2601 Spenwick Drive - Houston, TX 77055  
ph: 713.263.8001 - 800.231.3345 fax: 713.263.7577 - 800.441.0051  
www.rectorseal.com - Like Us on Facebook



0 21449 83119 2

# Installation Instructions


Model No.

# 83119

(EZT119)

## Important:

Install in strict accordance with RectorSeal instructions as well as all applicable local plumbing, drainage and electrical codes.

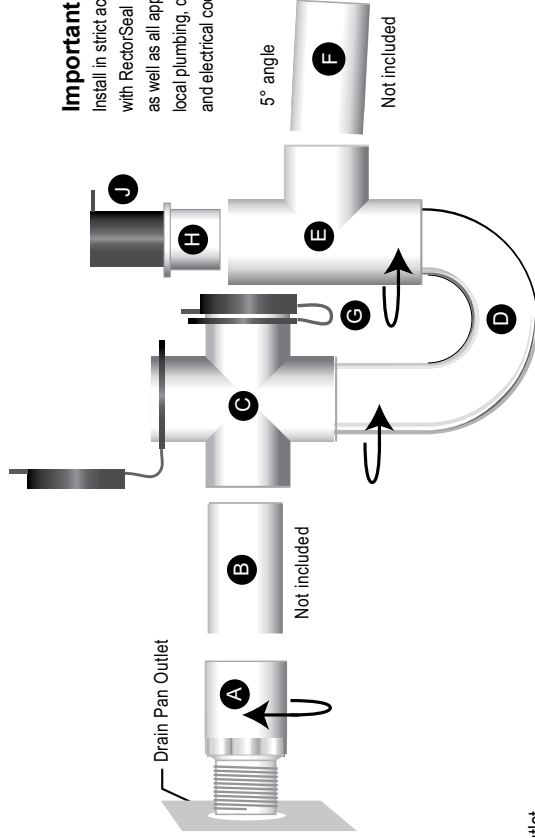

## Trap Assembly Instructions

1. Screw Adaptor (A) into 3/4" primary drain pan outlet.
  2. Dry fit, and mark components, rotating U-Bend (D) and Cross Tee (E) to required angles for installation.
  3. Glue components (B thru E) using dry fit markings. Then glue assembly into Adaptor (A). Assembly must be plumb.
  4. Glue Drain Line (F) into center leg of Outlet Tee (E) Drain Line must exit building with at least a 5° angle.
  5. Check that Red Caps (G) are tightly secured.
  6. Place Reducing Bushing (H) into top of Tee (E).
  7. Place Brush Holder (J) into Reducing Bushing (H) and place Cleaning brush into hole in Brush Holder.
  8. Attach service & cleaning labels as indicated.
- Note:** Insulation is required when trap is installed in unconditioned space where sweating can occur.